


## LVL HOLE DETAILS

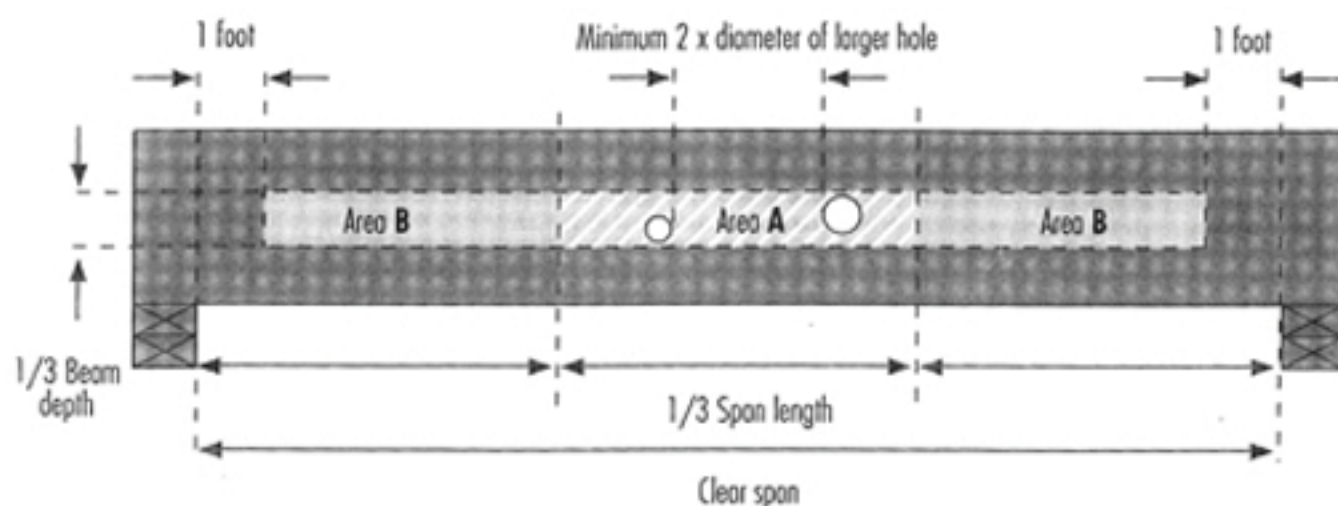

### NOTES:

1. These guidelines apply to uniformly loaded beams selected from the Quick Reference Tables or the Uniform Load Tables or designed with design/specification software only. For all other applications, such as beams with concentrated loads, please contact your LP Engineered Wood Products distributor for assistance.
2. Round holes can be drilled anywhere in "Area A" provided that: no more than four holes are cut, with the minimum spacing described in the diagram. The maximum hole size is  $1\text{-}1/2"$  for depths up to  $9\text{-}1/4"$ , and  $2"$  for depths greater than  $9\text{-}1/4"$ .
3. Rectangular holes are NOT allowed.
4. DO NOT drill holes in cantilevers without prior approval from the project engineer/architect.
5. Other hole sizes and configurations MAY be possible with further engineering analysis. For more information, contact your LP Engineered Wood Products distributor.
6. Up to three  $3/4"$  holes may be drilled in "Area B" to accommodate wiring and/or water lines. These holes must be at least  $12"$  apart. The holes should be located in the middle third of the depth, or a minimum of  $3"$  from the bottom of the beam. For beams shallower than  $9\text{-}1/4"$ , locate holes at mid-depth.
7. Protect plumbing holes from moisture.